


# Mod: SAIGON PLUS

## Production code:

## Ref. Diamond

SG150PSSG003H	SG15B/A1-R2
SG200PSSG003H	SG20B/A1-R2
SG250PSSG003H	SG25B/A1-R2
SG300PSSG003H	SG30B/A1-R2
SG350PSSG003H	SG35B/A1-R2
SG150PSSG00AH	SG15B/B1-R2
SG200PSSG00AH	SG20B/B1-R2
SG250PSSG00AH	SG25B/B1-R2
SG300PSSG00AH	SG30B/B1-R2
SG350PSSG00AH	SG35B/B1-R2
SS150PSSG003H	SG15BS/A1-R2
SS200PSSG003H	SG20BS/A1-R2
SS250PSSG003H	SG25BS/A1-R2
SS300PSSG003H	SG30BS/A1-R2
SS350PSSG003H	SG35BS/A1-R2
SS150PSSG00AH	SG15BS/B1-R2
SS200PSSG00AH	SG20BS/B1-R2
SS250PSSG00AH	SG25BS/B1-R2
SS300PSSG00AH	SG30BS/B1-R2
SS350PSSG00AH	SG35BS/B1-R2

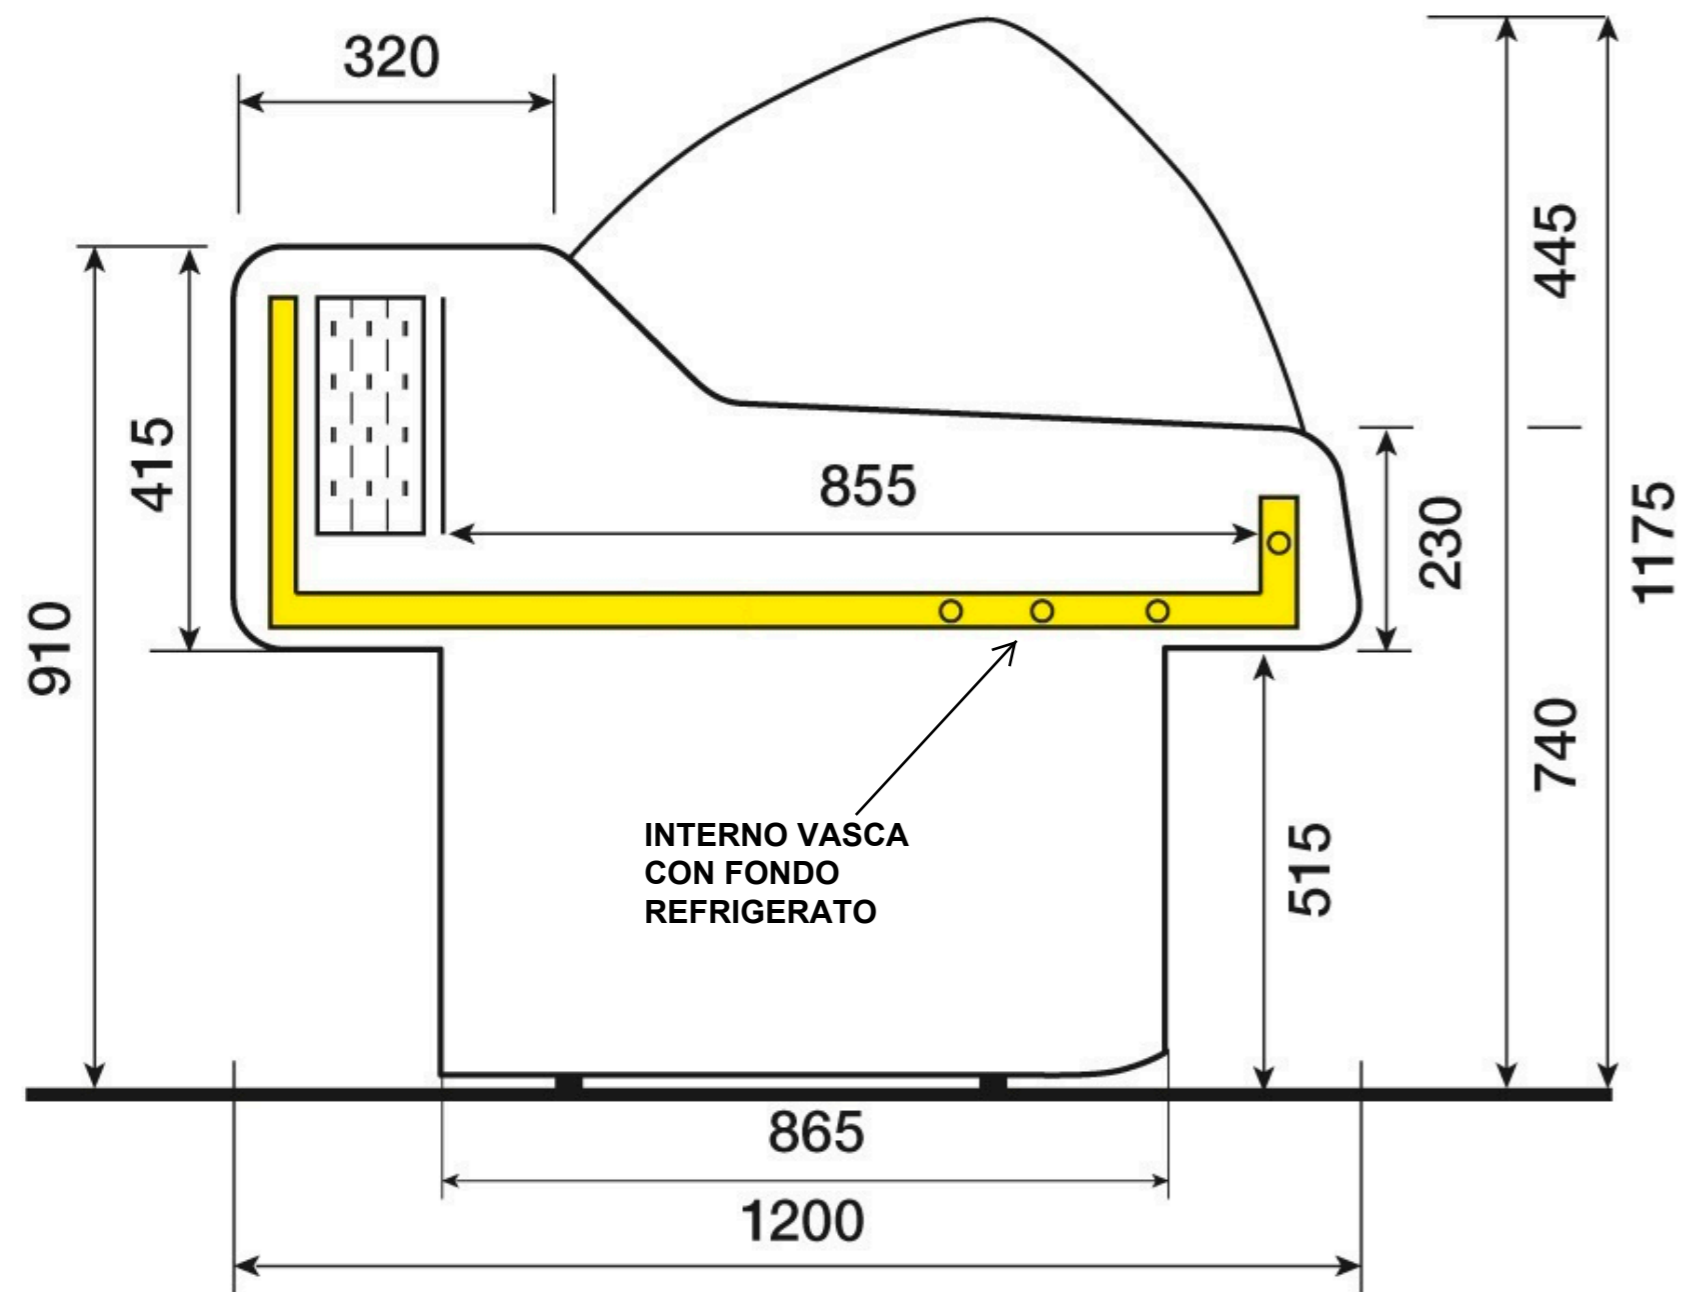

MODELLO	LUNG. LENGTH LAENGE LONGUEUR	MOTORE COMPRESSOR KOMPRESSOR COMPRESSEUR	ILLUMINAZIONE LIGHTING BELEUCHTUNG ILLUMINATION	QUANTITA' GAS GAS QUANTITY GAS MENGE QUANTITE' DE GAS (KG.)	TIPO DI GAS KIND OF GAS GAS-TYP TIPE DE GAZ	HP	Potenza frigorifera Refrigeration power Kalteleistung Puissance frigorifique Watt (-10°C)	Watt assorbiti Watt absorbed Nennleistungsaufnahme Watts absorbés	Assorbimento Ventilatori Fab absorption Luefteraufnahmen Absorption ventilateurs (W)	TUBI TUBES RÖHREN TUBES (mm)	
SAIGON	<b>STATICO - STATISCH - STATIC - STATIQUE - ESTATICA</b>									<i>S</i>	<i>D</i>
	150	NEU6210GK	/	0,100	R 290	1/2	690	373	/	8	6
	200	NEK6213GK	/	0,115	R 290	1/2+	873	537	/	8	6
	250	NEU6217GK	/	0,130	R 290	3/4+	1115	550	/	8	6
	300	NT6222GK	/	0,150	R 290	1-	1358	845	/	8	6
	350	NST26RA	/	0,150	R 290	1+	1648	1258	/	10	6

S= ASPIRAZIONE - SUCTION - ASPIRATION - SAUG  
D= MANDATA (PER VALVOLA) - DISCHARGE - DECHARGE - DRUCK

I dati delle unità si riferiscono alla versione con gruppo incorporato. Per la versione gruppo a distanza il calcolo deve essere fatto dal frigorista.  
The data of the units refer to the version with built-in unit. For the version with remote unit, the calculation has to be made by the technician.  
Die Angaben des Kühlaggregats sind für die Ausführung mit eingebautem Aggregat. Für die Ausführung mit externem Aggregat die Kalkulation muss vom Kälte-Techniker gemacht werden.  
Les données du groupe sont pour la version avec groupe incorporé. Pour la version avec groupe à distance le calcul doit être fait par le frigoriste.